

IMPORTANT NOTES

- A. HEADER BOX MUST BE FIELD PREPPED FOR INSTALLATION. FASTENING HARDWARE DEPENDANT UPON MOUNTING SURFACE OR WALL STRUCTURE OF INSTALLATION AREA IS NOT SUPPLIED.
- B. ACCESS HOLES ARE GENERALLY LOCATED THROUGH THE BACK OF THE HEADER BOX FOR CLEAN CONCEALED LOOK; ALTERNATIVELY THEY CAN BE THROUGH THE TOP OR ENDPLATE OF THE BOX WITH WIRING RUN THROUGH CODE APPROVED SURFACE CONDUIT.
1. ELECTRICAL SERVICE AND ALL HARD WIRING TO BE SUPPLIED BY QUALIFIED PROFESSIONAL CONTRACTOR WITHIN THE GUIDELINES OF THE ENFORCED LOCAL ELECTRICAL CODES.
2. ACCESS HOLES ARE ALWAYS AWAY FROM HINGE SIDE OF HEADER TO ENSURE CABLES & WIRING RUNS DO NOT INTERFERE WITH & GET CHAFED BY THE MECHANICS OF THE OPERATOR WITHIN THE HEADER.
3. HIGH VOLTAGE INCOMING POWER & LOW VOLTAGE WIRES CANNOT SHARE THE SAME ACCESS HOLE. HIGH VOLTAGE WIRES MUST BE ROUTED IN CONDUIT & SECURED AWAY FROM ALL LOW VOLTAGE WIRES. IF HEADER IS MOUNTED ON ALUMINUM FRAMING, HIGH & LOW VOLTAGE WIRING CAN BE ROUTED THROUGH VERTICAL & HORIZONTAL TUBES.
4. INCOMING (MAIN) POWER GROUND WIRE CANNOT SHARE THE SAME GROUNDING STUD AS SYSTEM GROUND WIRE. GROUND INCOMING (MAIN) POWER ACCORDINGLY.

APPLICATION:
HA-8 LOW ENERGY OPERATOR
WIRING REQUIREMENTS


NOTE:
 AUTOMATIC SWING DOOR OPERATOR SHALL BE "HA-8" CETL USA APPROVED, CONFORMING TO UL STD. 325 & ANSI-BHMA STD. A156.19 CERTIFIED TO CAN. CSA STD. C22.2#247 AS MANUFACTURED BY HUNTER ACCESS TECHNOLOGIES INC.
 32" CLEAR OPENING REQUIRED TO MEET ADA REQUIREMENT.

STANDARD FINISH: CLEAR ANODIZE, DARK BRONZE,
 SPECIAL FINISHES ARE AVAILABLE

MAIN INCOMING POWER, (MIP)
 120V AC, 60HZ, 15A. BY


ELECTRICAL CONTRACTOR

LOW VOLTAGE WIRING, (LVW)
 SEPARATE FROM INCOMING
 MAIN POWER TO CONTROL

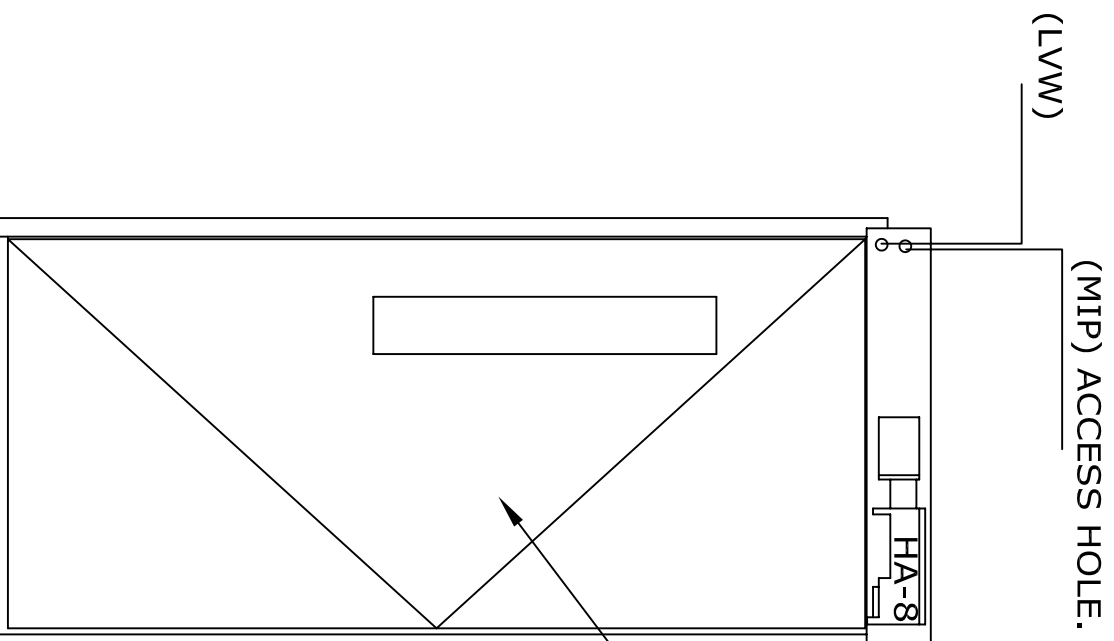


TYP. RIGHT HAND
 APPLICATION IS
 SHOWN. (LEFT
 HAND OPPOSITE).

SWING HOLLOW
 METAL, ALUMINUM
 OR WOOD DOORS
 AND FRAMES BY
 OTHERS TYP.

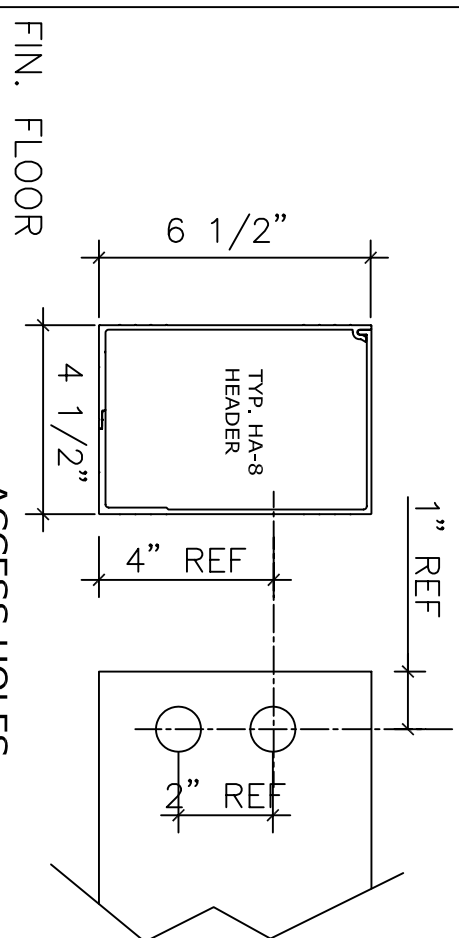

ACCESS HOLES
 TYP. 1" DIA. FOR
 CONDUIT FITTING.

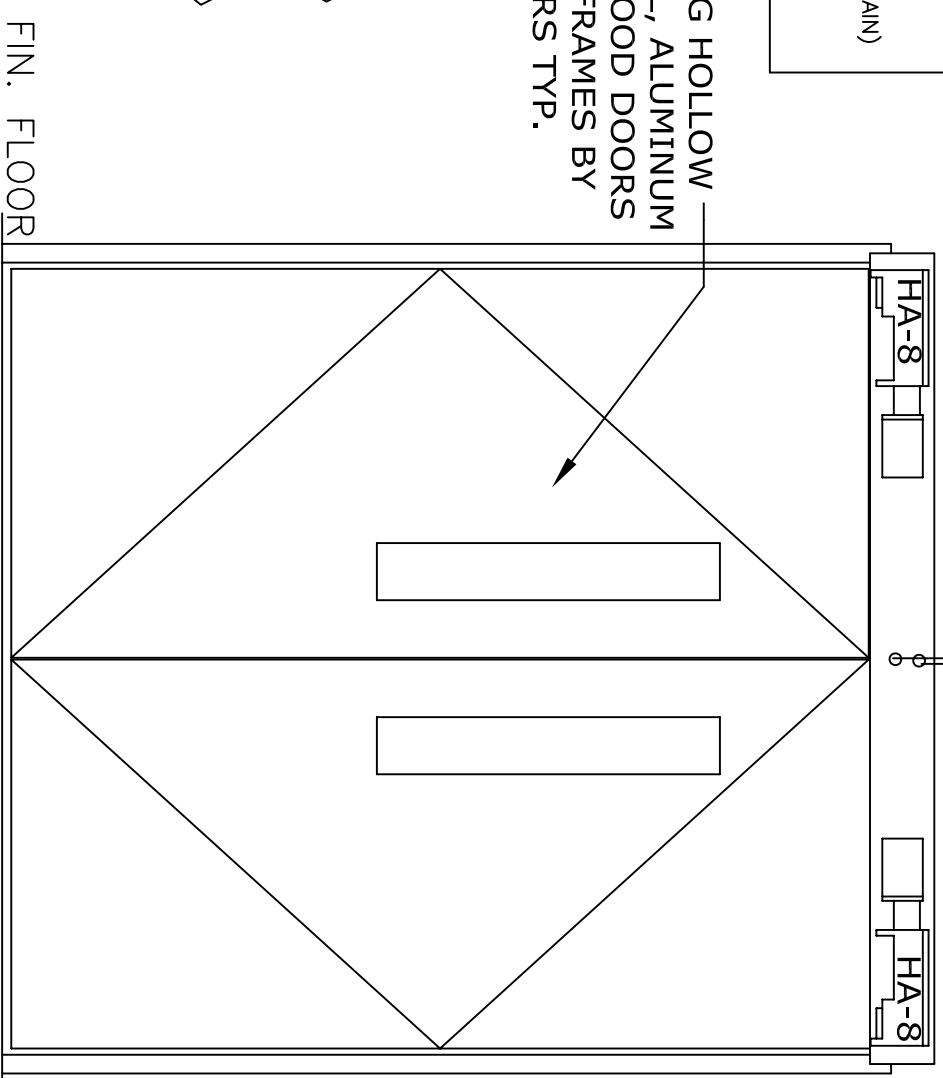

ELEVATION

ELEVATION

NOTE:
 HUNTER ACCESS TECHNOLOGIES INC. RESERVES
 THE RIGHT TO CHANGE & IMPROVE IT'S
 PRODUCTS & SPECIFICATIONS WITHOUT NOTICE.



125 KENYON DRIVE
 SUITE #3
 LAKEWOOD, NJ 08701
 TEL: 732-942-6099
 FAX: 732-942-6033
 www.hunteraccesstechnologies.com

SHEET TITLE:		SHEET NO.	
ARCHITECT:		16	
CONTRACTOR:		SECTION	
SCALE:	DRAWN BY:	DATE:	HA